

120t受水槽

揚水ポンプ

27t受水槽

※改修工事を
R9年度に計画


※新設

立上り基礎 幅450 高さ600
縦筋 D16@200ダブル
横筋 D13@200ダブル

耐圧版 t600
主筋・配力筋とも D16@200ダブル

3×3×3
30 m³ の受水槽
赤⇒受水槽工事
水色⇒建築基礎

- ①平野キャンパス研究棟裏受水槽（27 t）新設工事である。
- ②平日、土曜日の昼間での作業とする。
- ③施工については、施工場所や騒音、安全計画について監督員と十分に打合せを行うこと。
- ④高所作業の際は、安全を確保し、作業すること。
- ⑤教職員や学生の往来については十分注意すること。

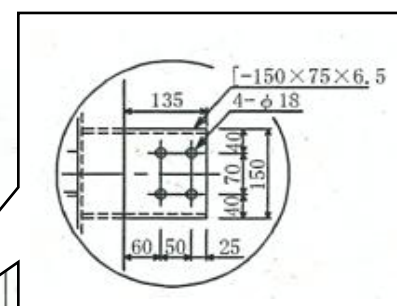

据付金具部詳細

Technical drawing of a three-column structure. The columns are labeled "ケミカルアンバー(SUS) M16(埋込長さ120L)". Dimensions are provided for column width (400), column spacing (1534), and total width (3068). Vertical dimensions include 170, 1025, 1018, 1364, and 3408. A leader line points to the top of the columns.

Technical drawing of a three-burner gas stove. The drawing shows a side view with dimensions in millimeters. The overall height is 3855 mm. The width of the stove is 600 mm. The distance between the burners is 2000 mm. The distance between the burners and the oven is 1000 mm. The oven has a height of 500 mm. The burners are arranged in a row, and the oven is located below them. The drawing also shows a control knob on the left side of the stove.